


**ABBREVIATIONS:**

<b>A</b>	AFF ABOVE FINISH FLOOR AL ALUMINUM ALT ALTERNATE APPL APPLIANCE ARCH ARCHITECT(URAL) AUTO AUTOMATIC AVG AVERAGE & AND	<b>K</b>	KIT KITCHEN
<b>B</b>	BLDG BUILDING BD BOARD BLKG BLOCKING	<b>L</b>	LAV LAVATORY LB POUND LF LINEAR FOOT (FEET) LT LIGHT LVR LOUVER
<b>C</b>	CAB CABINET CPT CARPET CER CERAMIC CLG CEILING CONC CONCRETE CONT CONTINUOUS CONTR CONTRACTOR COV COVER CMU CONCRETE MASONRY UNIT	<b>M</b>	MAX MAXIMUM MFD MANUFACTURED MFR MANUFACTURER MECH MECHANICAL MEMB MEMBRANE MEZZ MEZZANINE MIN MINIMUM MISC MISCELLANEOUS MLWK MILLWORK MTD MOUNTED
<b>D</b>	DBL DOUBLE DEPT DEPARTMENT DET DETAIL DF DRINKING FOUNTAIN DIA DIAMETER DIFF DIFFUSER DIM DIMENSION DISP DISPENSER DIV DIVISION DN DOWN \$ DOLLAR (US CURRENCY) DR DOOR DSCON DISCONNECT DWR DRAWER	<b>N</b>	NIC NOT IN CONTRACT NO. NUMBER NTS NOT TO SCALE
<b>E</b>	EIFS EXTERIOR INSULATED FINISH SYSTEM ELAST ELASTOMERIC ELEC ELECTRICAL ENGR ENGINEER(ED) EQ EQUAL EQUIP EQUIPMENT EXIST EXISTING EXP JT EXPANSION JOINT EXT EXTERIOR	<b>O</b>	OVFL OVERFLOW OVHD OVERHEAD OPNG OPENING(S) OPR OPERABLE
<b>F</b>	FAB FABRICATION FD FLOOR DRAIN FE FIRE EXTINGUISHER FEC FIRE EXTINGUISHER AND CABINET FHC FIRE HOSE CABINET FIN FINISH FLDG FOLDING FPLC FIREPLACE FR FIRE RAT(ED)(ING) FRMG FRAMING FXD DIXED FXTR FIXTURE FLR FLOOR(ING) FURN FURNITURE FWC FABRIC WALL COVERING	<b>P</b>	PTN PARTITION PBD PARTICLE BOARD PNL PANEL PREFIN PREFINISHED PREFAB PREFABRICATED PLAM PLASTIC LAMINATE PLAS PLASTER PLYWD PLYWOOD
<b>G</b>	GA GAUGE GFRC GLASS FIBER REINFORCED CONCRETE GFRG GLASS FIBER REINFORCED GYPSUM GFRP GLASS FIBER REINFORCED PLASTER GL GLASS GYP GYPSUM	<b>R</b>	RCP REFLECTED CEILING PLAN RECES RECESSED RECPT RECEPTACLE REF REFER REFL REFLECTED REFR REFRIGERATOR REQD REQUIRED REINFC(D) REINFORCE(D) RESIL RESILIENT REST RESTROOM RFG ROOFING RM ROOM RO ROUGH OPENING
<b>H</b>	HD HEAD HM HOLLOW METAL HOR HORIZONTAL HVAC HEATING, VENTILATING & AIR CONDITIONING	<b>S</b>	SF SQUARE FOOT (FEET) SGL SINGLE SIM SIMILAR SST STAINLESS STEEL STD STANDARD STL STEEL STRFR STOREFRONT STRUCT STRUCTURAL SURF SURFACE SUSP SUSPENDED SYS SYSTEM(S)
<b>I</b>	INFO INFORMATION INSUL INSULATION INT INTERIOR	<b>T</b>	THK THICK TLT TOILET TRANS TRANSPARENT TRTD TREATED T&G TONGUE & GROOVE TYP TYPICAL
<b>J</b>	JAN JANITOR	<b>U</b>	UTIL UTILITY UNO UNLESS NOTED OTHERWISE
		<b>V</b>	VIF VERIFY IN FIELD
		<b>W</b>	W/ WITH WC WATER CLOSET WD WOOD WDW WINDOW W/O WITHOUT WT WEIGHT WTRPRF WATERPROOF(ING)

**GRAPHIC SYMBOLS:**

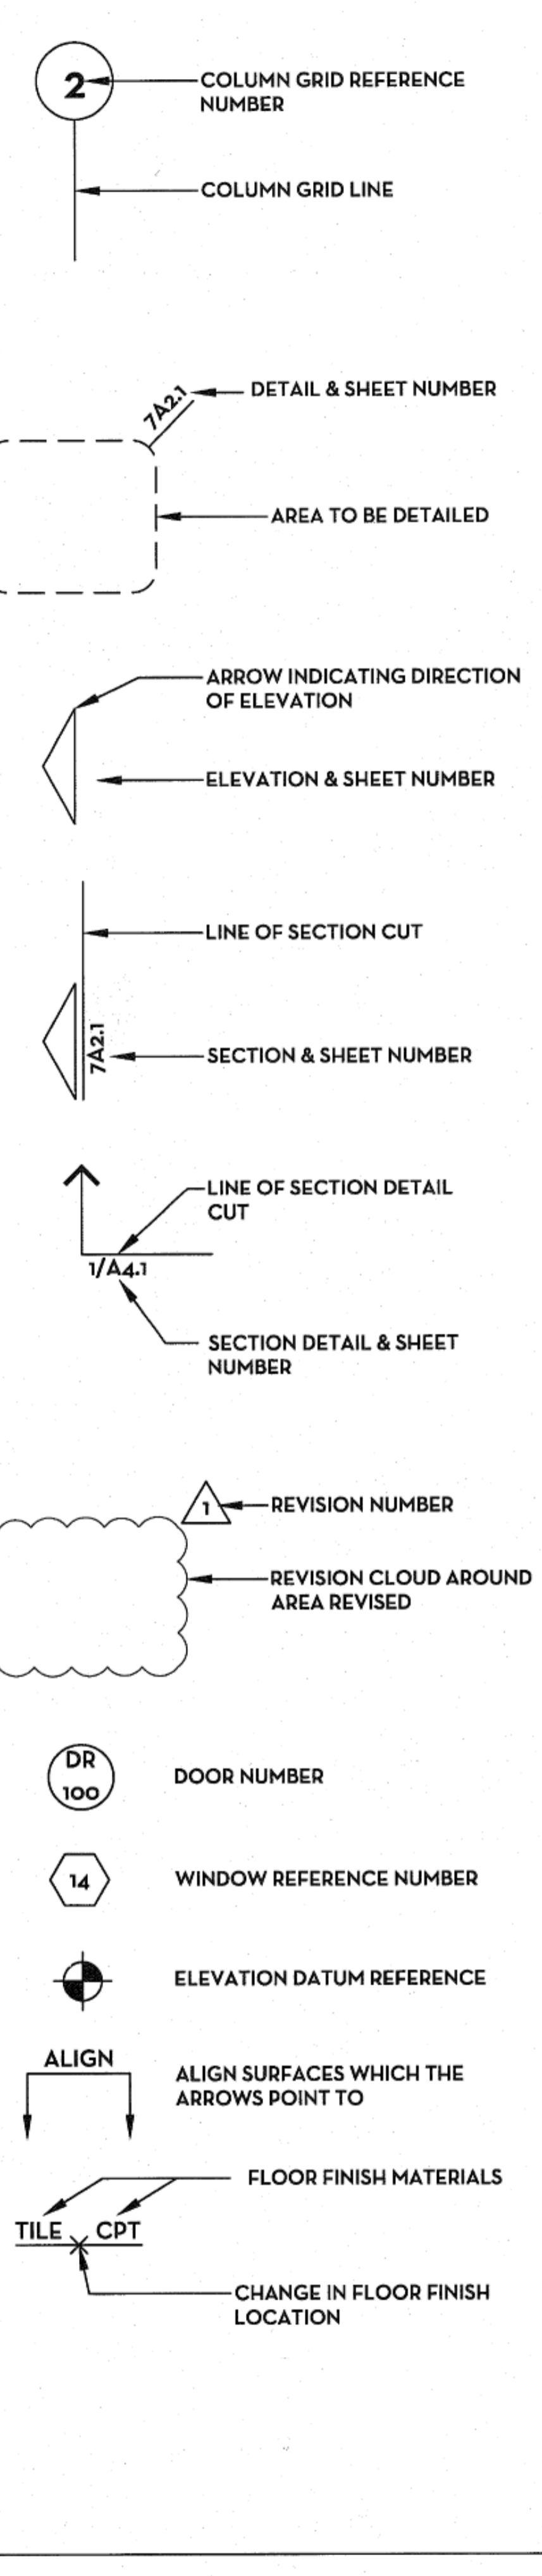

**FINISH NOTES:**

ENSURE SURFACES TO RECEIVE FINISHES ARE CLEAN, TRUE, AND FREE OF IRREGULARITIES. DO NOT PROCEED WITH WORK UNTIL UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED. REPAIR EXISTING SURFACES TO REMAIN AS REQUIRED FOR APPLICATION FOR NEW FINISHES. PROVIDE STRAIGHT, FLUSH RESILIENT BASE AT CARPETED AREAS, AND COVER, TOP SET RESILIENT BASE AT RESILIENT FLOORING, UNLESS OTHERWISE NOTED.

**REFLECTED CEILING NOTES:**

- DESIGN SUSPENDED CEILING FRAMING SYSTEM TO RESIST A LATERAL FORCE OF 20% OF THE WEIGHT OF THE CEILING ASSEMBLY AND ANY LOADS TRIBUTARY TO THE SYSTEM. USE A MINIMUM CEILING WEIGHT OF 5 POUNDS PER SQUARE FOOT TO DETERMINE THE LATERAL FORCE.
- WHERE CEILING LOADS DO NOT EXCEED 5 POUNDS PER SQUARE FOOT AND WHERE PARTITIONS ARE NOT CONNECTED TO THE CEILING SYSTEM, THE FOLLOWING BRACING METHODS MAY BE EMPLOYED.
  - PROVIDE LATERAL SUPPORT BY FOUR WIRES OF MINIMUM NO. 12 GAUGE SPLAYED IN FOUR DIRECTIONS 90 DEGREES APART, AND CONNECTED TO THE MAIN RUNNER WITHIN 2" OF THE CROSS RUNNER AND TO THE STRUCTURE ABOVE AT AN ANGLE NOT EXCEEDING 45 DEGREES FROM THE PLANE OF THE CEILING. PROVIDE THESE LATERAL SUPPORT POINTS 15 FEET ON CENTER IN EACH DIRECTION, WITH THE FIRST POINT WITHIN 4' FROM EACH WALL.
  - ALLOW FOR LATERAL MOVEMENT OF THE SYSTEM. ATTACHED MAIN RUNNERS AND CROSS RUNNERS AT TWO ADJACENT WALLS; MAINTAIN CLEARANCE BETWEEN THE WALL AND THE RUNNERS AT THE OTHER TWO WALLS.
  - PROVIDE VERTICAL SUPPORT AS REQUIRED IN BUILDING CODES. IN ADDITION, VERTICAL SUPPORT END OF RUNNERS 8" OF DISCONTINUITIES SUCH AS MAY OCCUR WHERE THE CEILING IS INTERRUPTED BY A WALL.
  - SUPPORT LIGHT FIXTURES AND AIR DIFFUSERS DIRECTLY BY WIRES TO THE STRUCTURE ABOVE.
  - LOCATE REGISTERS AND LIGHTING FIXTURES WITHIN GRID LINES. CENTER SPRINKLERS HEADS, SPEAKERS, RECESSED FIXTURES, AND SIMILAR CEILING ELEMENTS IN ACOUSTICAL UNITS, UNLESS OTHERWISE NOTED.
- FINISH HVAC DIFFUSERS, DRAPERY POCKETS AND SPEAKER GRILLES TO MATCH ADJACENT FINISH, UNLESS OTHERWISE NOTED.

**POWER & COMMUNICATION NOTES:**

- PRIOR TO CORING SLAB, REVIEW LOCATIONS WITH ARCHITECT AND COORDINATE LOCATIONS WITH OWNER.
- COORDINATE INSTALLATION OF TELECOMMUNICATIONS, DATA AND SECURITY SYSTEM.
- VERIFY EQUIPMENT SPECIFICATIONS, POWER AND INSTALLATIONS REQUIREMENTS WITH MANUFACTURER TO ENSURE PROPER FIT AND FUNCTION.
- VERIFY MOUNTING REQUIREMENTS OF ELECTRICAL, TELEPHONE AND OTHER EQUIPMENT.
- GANG ADJACENT LIGHT SWITCHES AND COVER WITH A SINGLE PLATE.
- PROVIDE LIGHT SWITCHING IN CONFORMANCE WITH TITLE 24 REQUIREMENTS. FOR ROOMS AND AREAS GREATER THAN 100 SQUARE FEET PROVIDED DOUBLE SWITCHES WITH EACH SWITCH CONTROLLING 50% OF LAMPS PER FIXTURES.
- MOUNT STANDARD WALL OUTLETS, SWITCH AND THERMOSTATS AT HEIGHT REQUIRED BY TITLE 24 AND ADA GUIDELINES, UNLESS OTHERWISE NOTED. WHEN THERMOSTATS AND LIGHT SWITCH OCCUR TOGETHER, INSTALL BOTH ALIGNED HORIZONTALLY WITH CENTER 3'-2" ABOVE FINISHED FLOOR.
- INDICATED DIMENSIONS ARE TO THE CENTER LINE OF OUTLETS OR SWITCH, OR CLUSTER OF OUTLETS OF SWITCH, UNLESS OTHERWISE NOTED.
- INSTALL OUTLETS ON OPPOSITE SIDES OF PARTITIONS IN SEPARATE STUD CAVITIES. DO NOT INSTALL BACK TO BACK.
- PROVIDE MATCHING COVER PLATES, RECEPTACLE AND RELATED ITEMS. PROVIDE ONE PIECE TYPE GANG COVER PLATES, UNLESS OTHERWISE NOTED.
- IDENTIFY DEDICATED OR ISOLATED GROUND ELECTRICAL OUTLETS WITH A RED DOT.

**FIRE DEPARTMENT NOTES:**

- PROVIDE A PORTABLE FIRE EXTINGUISHER WITH A RATING OF NOT LESS THAN 2-A WITHIN 75 FOOT TRAVEL DISTANCE TO ALL PORTIONS OF THE BUILDING ON EACH FLOOR AND ADDITIONAL EXTINGUISHERS AS REQUIRED BY FIRE DEPARTMENT FIELD INSPECTORS OR BUILDING DEPARTMENT INSPECTOR.
- PROVIDE EXIT SIGN WITH 6" LETTERS OVER REQUIRED EXITS. WHERE SHOWN ON DRAWINGS, AND ADDITIONAL SIGNS AS REQUIRED BY BUILDING DEPARTMENT INSPECTORS OR FIRE DEPARTMENT FIELD INSPECTORS. CONNECT EXITS SIGNS TO EMERGENCY POWER CIRCUITS. COMPLY WITH BUILDING CODES.
- PROVIDE EMERGENCY LIGHTING OF ONE FOOT CANDLE AT FLOOR LEVEL. COMPLY WITH BUILDING CODES.
- EVERY EXIT DOOR SHALL BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT. SPECIAL LOCKING DEVICES SHALL BE OF AN APPROVED TYPE. ALL NEW DOORS SHALL HAVE APPROVED LEVEL HANDLES.
- DOOR OPENING INTO REQUIRED 1-HOUR, FIRE RESISTIVE CORRIDORS SHALL BE PROTECTED WITH A SMOKE DRAFT STOP ASSEMBLY HAVING A 20 MINUTE RATING AND SHALL BE SELF CLOSING.
- 20-MINUTE DOOR JAMBS TO BE TIGHT-FITTING, SMOKE AND DRAFT CONTROLLED.
- EXIT DOORS SHALL SWING IN THE DIRECTION OF TRAVEL WHEN SERVING 50 OR MORE PERSONS AND ANY HAZARDOUS AREA.
- INTERIOR WALL AND CEILING FINISHES FOR EXIT CORRIDORS SHALL NOT EXCEED AN END POINT FLAME SPREAD RATING, A CLASS I, FLAME SPREAD 0-25, SMOKE DENSITY 150, FOR MATERIALS INSTALLED IN VERTICAL EXITS. B CLASS II, FLAME SPREAD 26-75, SMOKE DENSITY 300, FOR MATERIALS INSTALLED IN HORIZONTAL EXITS. C CLASS III, FLAME SPREAD 76-200, SMOKE DENSITY 450 FOR MATERIALS INSTALLED IN ANY OTHER LOCATION.
- DECORATIONS (CURTAINS, DRAPES, SHADES, HANGINGS, ETC.) SHALL BE NON-COMBUSTIBLE OR BE FLAME PROOFED IN AN APPROVED MANNER.
- PROVIDE FIRE DAMPERS OR DOOR WHERE AIR DUCTS PENETRATE FIRE-RATED WALLS OR CEILINGS.
- STORAGE, DISPENSING OR USE OF ANY FLAMMABLE OR COMBUSTIBLE LIQUIDS, FLAMMABLE GAS AND HAZARDOUS SUBSTANCES SHALL COMPLY WITH UNIFORM FIRE CODE REGULATIONS. WOOD BLOCKING SHALL BE FIRE TREATED IN ACCORDANCE WITH APPLICABLE CODE REQUIREMENTS.
- EXTEND OR MODIFY EXISTING FIRE/LIFE SAFETY SYSTEM AS REQUIRED TO PROVIDE AN APPROVED FIRE/LIFE SAFETY SYSTEM. SUBMIT PLANS TO FIRE DEPARTMENT WITH COMPLETE DESCRIPTION OF SEQUENCE OF OPERATION AND OBTAIN APPROVAL PRIOR TO INSTALLATION.
- LOCATE THE CENTER OF FIRE ALARM INITIATING DEVICE 48" ABOVE LEVEL OF THE FLOOR, WORKING PLATFORM, GROUND SURFACE OF SIDEWALK.
- EMERGENCY WARNING SYSTEM SHALL ACTIVATE A MEANS OF WARNING FOR THE HEARING IMPAIRED. FLASHING VISUAL WARNING SHALL HAVE A FREQUENCY OF NOT MORE THAN 60 FLASHES PER MINUTE.
- EXTEND OR MODIFY EXISTING AUTOMATIC FIRE EXTINGUISHERS SYSTEM AS REQUIRED TO PROVIDE AND APPROVED AUTOMATIC FIRE EXTINGUISHERS SYSTEM. SUBMIT PLANS TO FIRE DEPARTMENT AND OBTAIN APPROVAL PRIOR TO INSTALLATION.
- AUTOMATIC SPRINKLER SYSTEM SHALL BE SUPERVISED BY AND APPROVED CENTRAL, PROPRIETARY OR REMOTE STATION SERVICE OR A LOCAL ALARM WHICH WILL GIVE AN AUDIBLE SIGNAL AT A CONSTANTLY ATTENDED LOCATIONS.

**DISABLED ACCESS NOTES:**

- IN BUILDINGS AND FACILITIES, FLOORS OF A GIVEN STORY SHALL BE A COMMON LEVEL THROUGHOUT, OR SHALL BE CONNECTED BY PEDESTRIAN RAMPS, PASSENGER ELEVATIONS OR SPECIAL ACCESS LIFTS.
- FLOOR SURFACES SHALL BE SLIP-RESISTANT.
- EVERY CORRIDOR AND AISLE SERVING AN OCCUPANT LOAD OF 10 OR MORE SHALL BE NOT LESS THAN 44" IN WIDTH.
- ABRUPT CHANGES IN LEVEL ALONG ANY ACCESSIBLE ROUTE SHALL NOT EXCEED 1/2" IN HEIGHT. LEVEL CHANGES NOT EXCEEDING 1/2" MAY BE VERTICAL. BEVEL OTHERS WITH A SLOPE NO GREATER THAN 1:2.
- LATCHING AND LOCKING DOORS THAT ARE HAND ACTIVATED AND WHICH ARE IN A PATH OF TRAVEL SHALL BE OPERABLE WITH A SINGLE EFFORT BY LEVER TYPE HARDWARE, PANIC BARS, PUSH-PULL ACTIVATING BARS, OR BY OTHER HARDWARE DESIGNED TO PROVIDE PASSAGE WITHOUT REQUIRING THE ABILITY TO GRASP THE OPENING HARDWARE. MOUNT DOOR OPENING HARDWARE BETWEEN 30" AND 44" ABOVE FLOOR FINISH.
- CENTER HAND ACTIVATED DOOR OPENING HARDWARE BETWEEN 30" AND 44" ABOVE THE FLOOR.
- MAXIMUM PULL OR PUSH EFFORT TO OPERATE DOORS SHALL NOT EXCEED 8.5 POUNDS FOR EXTERIOR DOORS AND 5 POUNDS FOR INTERIOR DOORS, MEASURED AT RIGHT ANGLES TO HINGE DOORS AND AT CENTER PLANE OF SLIDING OR FOLDING DOORS CORRESPONDING DEVICES OR AUTOMATIC DOOR OPERATIONS MAY BE UTILIZED TO MEET THE ABOVE STANDARDS. MAXIMUM EFFORT TO OPERATE REQUIRED FIRE DOORS MAY BE INCREASED NOT TO EXCEED 15 POUNDS.
- THE BOTTOM 10" OF ALL DOORS (EXCEPT SLIDING AND AUTOMATIC) SHALL HAVE A SMOOTH UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOT REST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION. PROVIDE A 10" HIGH SMOOTH PANEL ON THE PUSH SIDE OF NARROW FRAME DOORS.
- EVER REQUIRED ENTRANCE OR PASSAGE DOORWAY SHALL BE NOT LESS THAN 3' IN WIDTH AND NOT LESS THAN 6'-8" IN HEIGHT. DOORS SHALL BE CAPABLE OF OPENING AT LEAST 90 DEGREES AND SHALL BE SO MOUNTED THAT THE CLEAR WIDTH OF THE DOORWAY IS NOT LESS THAN 32".
- WHERE A PAIR OF DOORS IS UTILIZED, AT LEAST ONE OF THE DOORS SHALL PROVIDE A CLEAR, UNOBSTRUCTED OPENING WIDTH OF 32" WITH THE LEAF POSITIONED AT AN ANGLE OF 90 DEGREES FROM ITS CLOSED POSITION.
- IDENTIFY ACCESSIBLE ENTRANCES WITH AT LEAST ONE STANDARD SIGN AND WITH ADDITIONAL DIRECTIONAL SIGNS, AS REQUIRED, VISIBLE FROM APPROACHING PEDESTRIAN WAYS.
- THE FLOOR OR LANDING ON EACH SIDE OF AN ENTRANCE OR PASSAGE DOOR SHALL BE LEVEL AND CLEAR. THE LEVEL AND CLEAR AREA SHALL HAVE A LENGTH IN THE DIRECTION OF DOORS SWING OF AT LEAST 60" AND THE LENGTH OPPOSITE THE DIRECTION OF THE DOOR SWING OF 44" AS MEASURED AT RIGHT ANGLES TO THE PLANE OF THE DOOR IN ITS CLOSED POSITION.
- FLOORS OR LANDINGS SHALL BE MORE THAN 1/2" LOWER THAN THE THRESHOLD OF THE DOORWAY. CHANGE IN LEVEL BETWEEN 1/4" AND 1/2" SHALL BE BEVELED WITH A SLOPE NOT GREATER THAN 1:2.
- TO ALERT THE VISUALLY IMPAIRED, MARK THE UPPER APPROACH AND THE LOWER TREAD OF EACH INTERIORS STAIR WITH A STRIP OF CLEARLY CONTRASTING COLOR AT LEAST 2" WIDE, PLACED PARALLEL TO AND NOT MORE THAN 1" FROM THE NOSE OF THE STEP OR LANDING. THE STRIP SHALL BE OF A MATERIAL THAT IS LEAST SLIP RESISTANT AS THE OTHER TREADS OF THE STAIR.
- CENTER ELECTRICAL RECEPTACLE OUTLETS NOT LESS THAN 15" ABOVE THE FLOOR OF WORKING PLATFORM.
- SANITARY FACILITIES LOCATED ON AN ACCESSIBLE FLOOR OF A BUILDING SHALL BE ACCESSIBLE TO THE PHYSICALLY HANDICAPPED.
- ENTRY TO SANITARY FACILITIES
  - A 44" CLEAR AISLE OR CORRIDORS WHERE OCCUPANTS LOAD 10 OR MORE.
  - DOORWAY TO HAVE A 32" CLEAR OPENING.
  - ON APPROACH SIDE, PROVIDE A 60" CLEAR LEVEL SPACE WHEN DOOR SWINGS TOWARD APPROACH AND 44" SPACE WHEN DOOR SWINGS AWAY FROM APPROACH.
- TOILET ROOM ACCESSORIES
  - MOUNT BOTTOM EDGE OF MIRRORS NO HIGHER THAN 40" FROM THE FLOOR.
  - MOUNT TOILET TISSUE DISPENSERS WITH IN 12" FROM THE FRONT EDGE OF THE TOILET SEAT.
  - MOUNT DISPENSING AND DISPOSAL FIXTURES (TOWELS, SANITARY NAPKINS, WASTE, COIN SLOTS, ETC.) WITH OPERATING PARTS NO HIGHER THAN 40" FROM THE FLOOR.
- SINGLE ACCOMMODATION TOILET FACILITY
  - WATER CLOSET TO HAVE A 28" CLEARANCE FROM A FIXTURE AND 32" FROM A WALL.
  - MINIMUM CLEAR SPACE IN FRONT OF WATER CLOSET TO BE 48".
  - A SPACE 36" X 48" IS PERMITTED IN FRONT OF EXISTING WATER CLOSET ACCESSIBLE TO THE HANDICAPPED.
- THE HEIGHT OF THE WATER CLOSET (TOP OF SEAT) SHALL BE BETWEEN 17" AND 19".
- MOUNT FLUSH VALVE CONTROL NO MORE THAN 44" ABOVE THE FLOOR ON THE SIDE OF THE TOILET WITH THE GREATEST SEPARATION FROM THE ADJACENT WALL OR OTHER SURFACE.
- PROVIDE GRAB BARS ON EACH SIDE, OR SIDE AND BACK OF WATER CLOSET.
  - GRAB BARS TO BE 33" ABOVE AND PARALLEL TO THE FLOOR.
  - SIDE BARS TO BE 42" LONG AND PROJECT 24" IN FRONT OF WATER CLOSET STOOL. GRAB BAR AT BACK TO BE 36" LONG.
  - DIAMETER OF GRAB BARS TO BE 1-1/2" TO 1-3/4".
  - PROVIDE 1-1/2" CLEARANCE BETWEEN GRAB BARS AND WALLS.
  - GRAB BARS (INCLUDING CONNECTORS, FASTENERS, SUPPORT BACKING, ETC.) SHALL SUPPORT A 250 POUND LOAD.
  - GRAB BARS SHALL NOT ROTATE WITHIN THEIR FITTINGS.
  - GRAB BARS AND ANY ADJACENT SURFACE SHALL BE FREE OF SHARP OR ABRASIVE ELEMENTS.
- EDGES SHALL HAVE A MINIMUM RADIUS OF 1/8".
- PROVIDE A CLEAR FLOOR SPACE 30" X 48" IN FRONT OF LAVATORY TO PERMIT A FORWARD APPROACH.
- MOUNT LAVATORIES WITH A MINIMUM CLEARANCE OF 29" FROM THE FLOOR TO THE BOTTOM OF THE APRON. PROVIDE KNEE CLEARANCE UNDER THE FRONT LIP EXTENDING A MINIMUM OF 30" IN WIDTH WITH AN 8" MINIMUM WIDTH, AND SHALL BE A MINIMUM OF 9" HIGH FROM THE FLOOR A MINIMUM OF 17" DEEP FROM THE FRONT OF THE LAVATORY.
- FAUCETS CONTROLS AND OPERATING MECHANISMS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE CONTROLS SHALL BE NO GREATER THAN 5 POUNDS. LEVER OPERATED PUSH TYPE AND ELECTRONICALLY CONTROLLED MECHANISMS ARE EXAMPLES OF ACCEPTABLE DESIGNS. SELF CLOSING ARE ALLOWED IF THE FAUCET REMAINS OPEN FOR AT LEAST 10 SECONDS.
- INSULATE OR OTHERWISE COVER HOT WATER AND DRAIN PIPES UNDER LAVATORIES.
- THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER LAVATORIES.


**GENERAL NOTES:**

- COMPLY WITH ALL CODES, LAWS, ORDINANCES, RULES AND REGULATIONS OF PUBLIC AUTHORITIES GOVERNING THIS WORK.
- OBTAIN AND PAY FOR PERMITS AND INSPECTIONS AS REQUIRED BY THE AUTHORITIES GOVERNING THIS WORK.
- REVIEW THESE DOCUMENTS, VERIFY DIMENSIONS AND EXISTING CONDITIONS AND CONFIRM THAT THE WORK IS BUILDABLE AS SHOWN. REPORT ANY CONFLICTS OR OMISSIONS TO THE ARCHITECT FOR CLARIFICATION PRIOR TO ORDERING ANY MATERIALS OR PERFORMING ANY WORK IN QUESTION.
- SUBMIT REQUESTS FOR SUBSTITUTIONS, REVISIONS, OR CHANGES TO THE ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO PURCHASE, FABRICATION OR INSTALLATION.
- COORDINATE WORK WITH THE OWNER, INCLUDING SCHEDULING TIME AND LOCATIONS FOR DELIVERIES, PROPERTY AND/OR BUILDING ACCESS, USE OF SERVICES AND FACILITIES, AND USE OF ELEVATORS. MINIMIZE DISTURBANCE OF BUILDING FUNCTIONS AND OCCUPANTS.
- WORK NOTED "BY OTHERS" OR "NIC" WILL BE PROVIDED BY THE OWNER UNDER A SEPARATE CONTRACT. INCLUDE SCHEDULE REQUIREMENTS IN THE CONSTRUCTION PROGRESS SCHEDULE AND COORDINATE WITH OWNER TO ENSURE ORDERLY SEQUENCE OF INSTALLATION OF ALL WORK, INCLUDING "NIC" AND "BY OTHERS" WORK.
- COORDINATE THE INSTALLATION OF TELECOMMUNICATIONS, DATA AND SECURITY SYSTEMS WITH THE PROPER PARTIES.
- MAINTAIN EXITS, EXIT LIGHTING, FIRE PROTECTIVE DEVICES, AND ALARMS IN CONFORMANCE WITH APPLICABLE CODES AND ORDINANCES.
- PROTECT WORK AND SURROUNDING AREAS FROM DAMAGE.
- MAINTAIN WORK AREAS SECURE AND LOCKABLE DURING CONSTRUCTION. COORDINATE WITH TENANT AND LANDLORD TO ENSURE SECURITY.
- DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS GOVERN. CONSULT THE ARCHITECT IN CASE OF CONFLICT.
- PARTITIONS, FLOORS AND CEILINGS ARE DIMENSIONED FROM FINISH FACE TO FINISH FACE, UNLESS OTHERWISE NOTED. MAINTAIN DIMENSIONS MARKED "CLEAR". ALLOW FOR THICKNESS OF FINISHES.
- COORDINATE AND PROVIDE BACKING FOR MILLWORK AND ITEMS ATTACHED OR MOUNTED TO WALLS OR CEILINGS.
- WHERE EXISTING ACCESS PANELS CONFLICT WITH CONSTRUCTION, RELOCATE PANELS TO ALIGN WITH AND FIT WITH NEW CONSTRUCTION.
- UNDERCUT DOORS TO CLEAR TOP OF FLOOR FINISHES BY 1/2", UNLESS OTHERWISE NOTED.

**PROJECT INFORMATION:**

PROJECT ADDRESS: 11935 Belfort Village Dr, Houston, Texas 77031

**LOCATION MAP:**

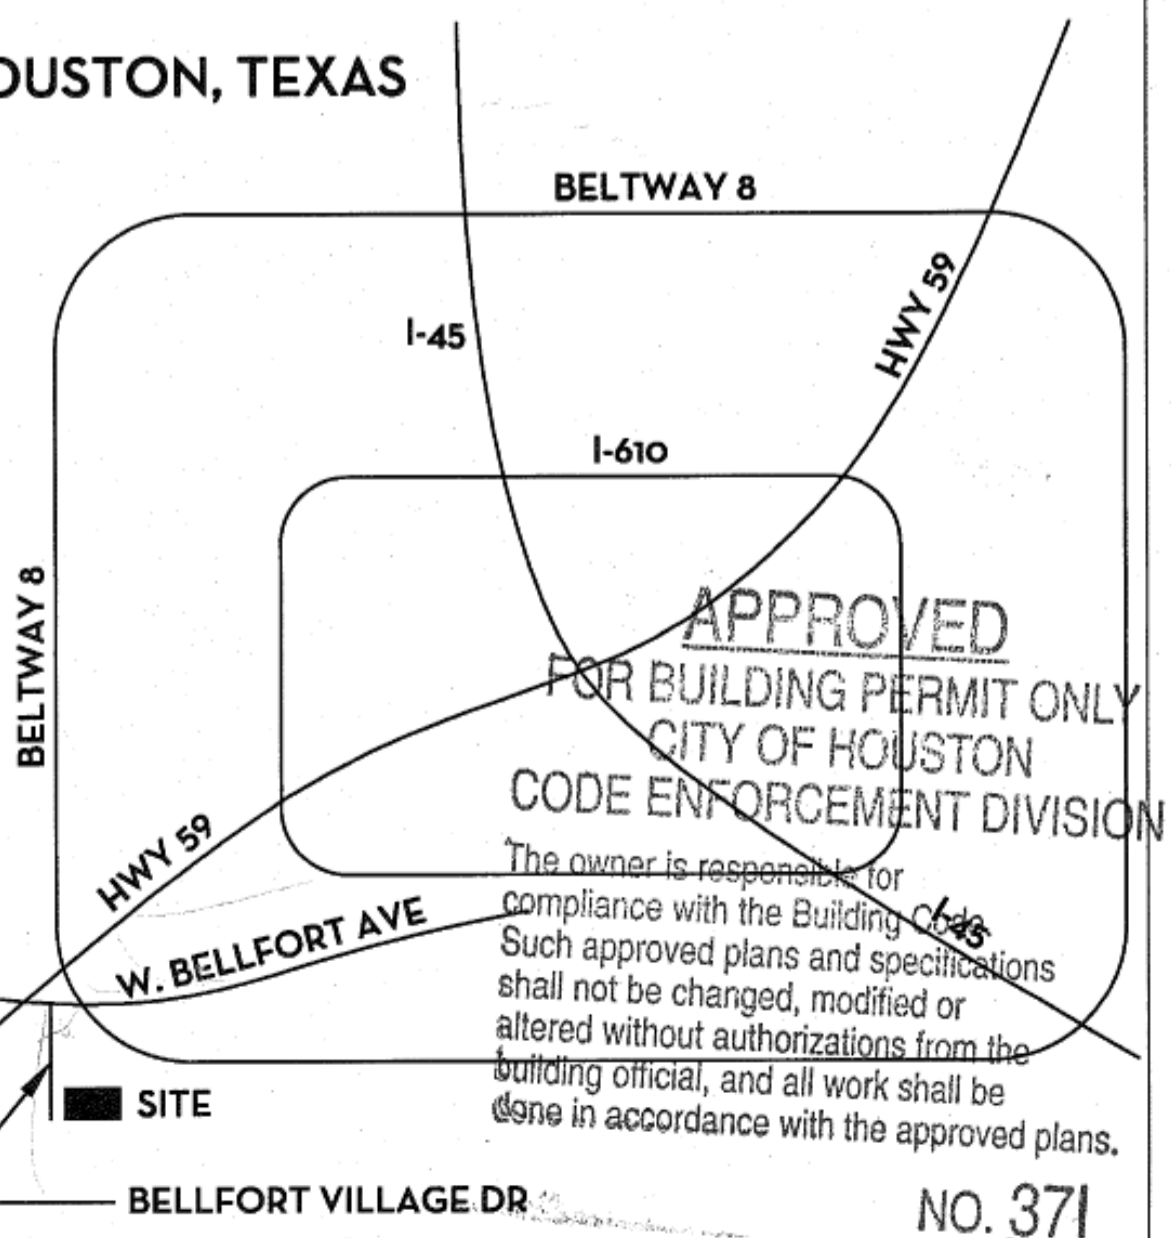

Our Lady of the Cedars  
Maronite Catholic Church  
Georges Mouawad Pastoral Center  
11935 Belfort Village Dr. #C, Houston, Texas 77031

**KASHOU**  
architecture

Kashou Architecture  
20710 Shadow Mill Ct  
Katy, Texas 77450  
Tel: 713. 965 4470

Structural Engineer:  
C.E.N.G. Engineers & Consultants

MEP & Civil Engineers:  
Innovative Engineering Design

Drawings and Specifications prepared by Kashou Architecture, Inc. or their consultants, whether in electronic or hard copy, are copyrighted instruments of service for use solely with respect to the project and the physical address provided in these documents. Reproduction of the instruments of service is deemed to be the sole responsibility of the user. The user shall be responsible for obtaining and maintaining the Project, provided the license has not been terminated by Kashou Architecture, Inc. Unauthorized reproduction of these instruments of service is a violation of federal laws. Use of these instruments of service for other projects is strictly prohibited. ©2009 Kashou Architecture, Inc. All Rights Reserved.



12/22/2009

Issued for:  
Permit & Construction 12/22/2009

Project No.

Dwg. Name  
**General Notes**

Dwg. No.

**Ao.01**