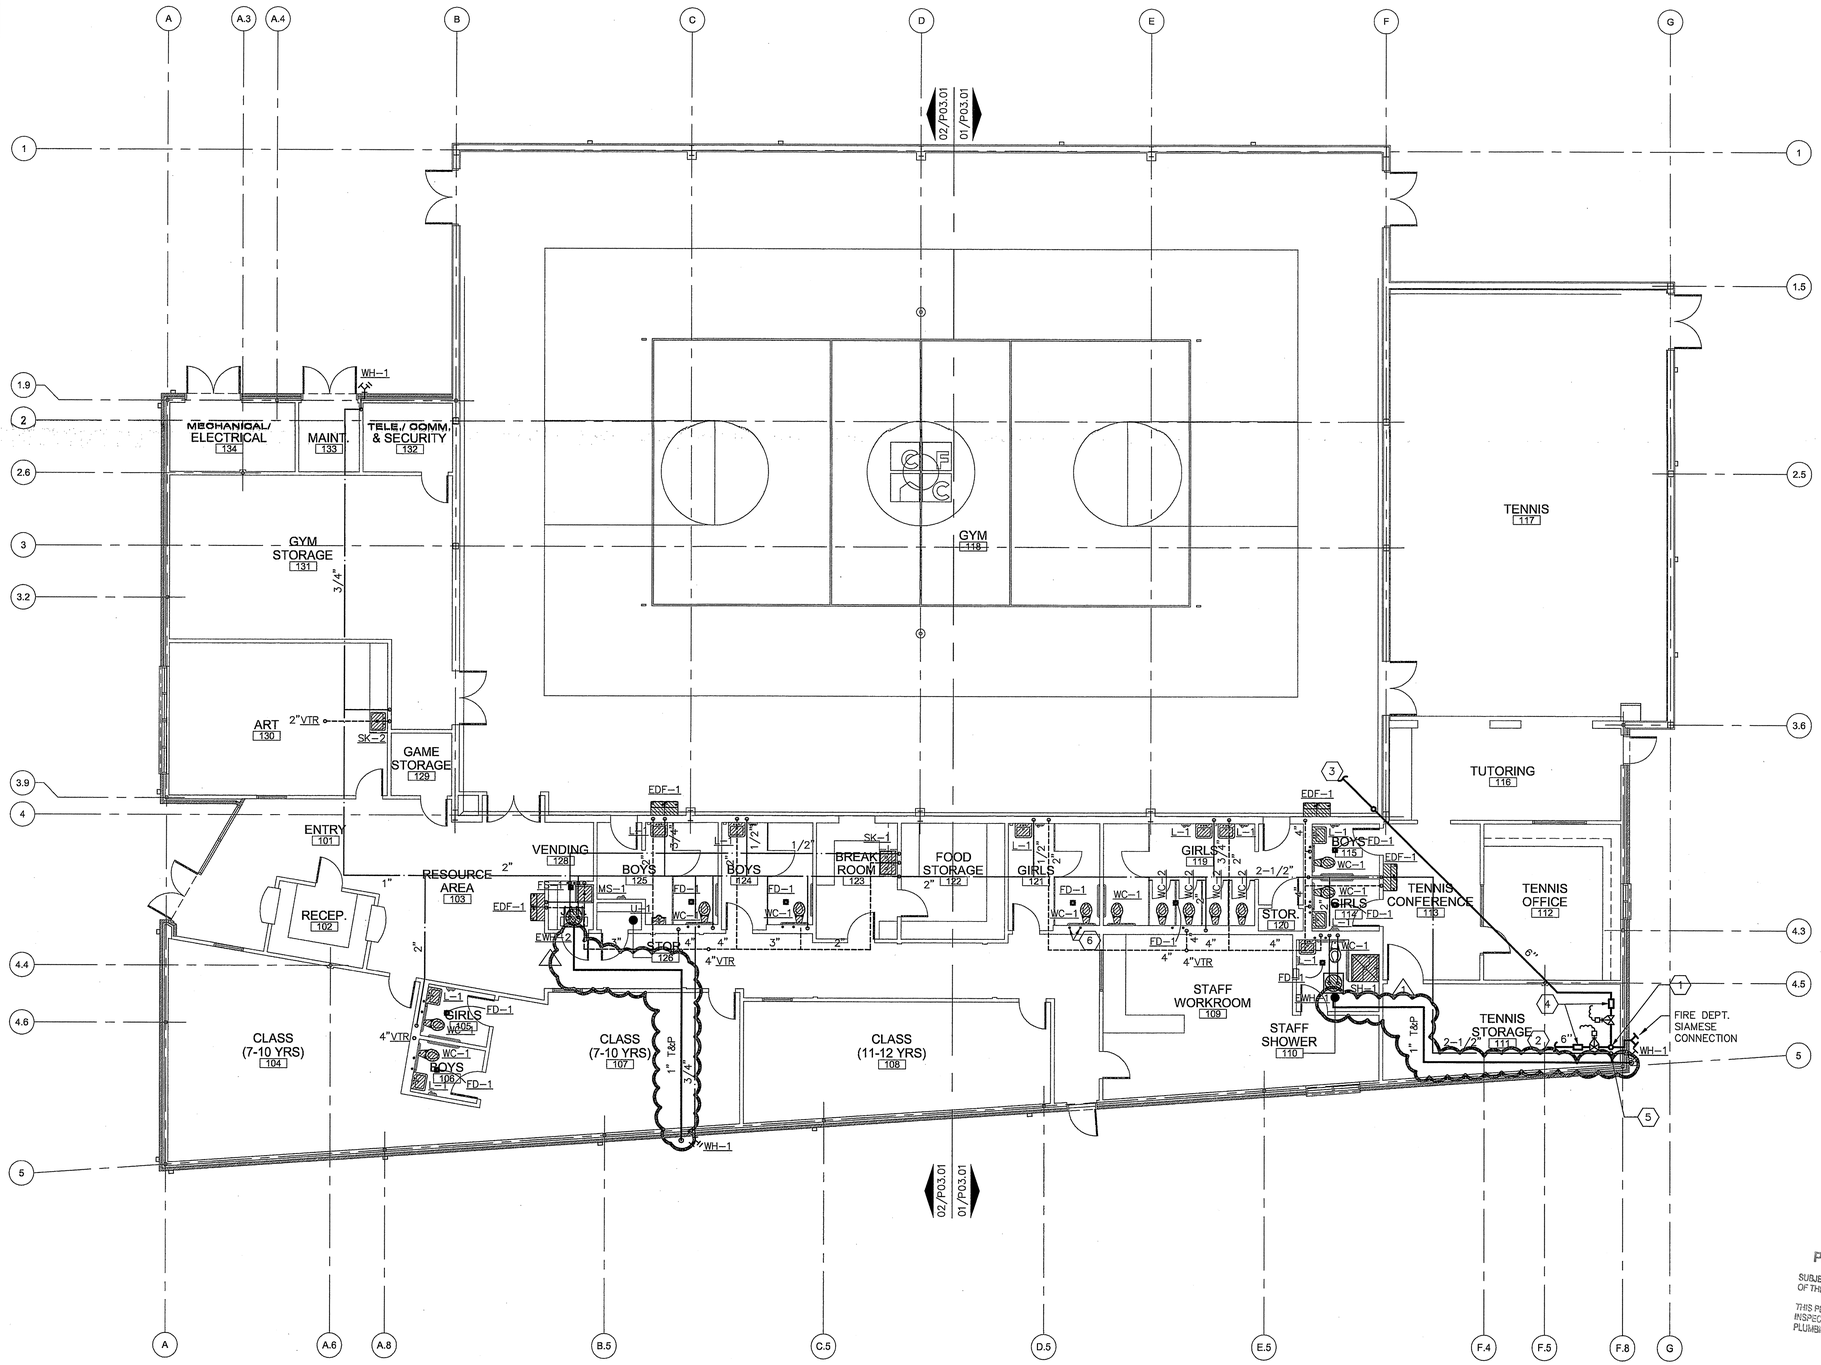

PLUMBING KEYED NOTES:

1. FIRE SPRINKLER ENTRANCE ASSEMBLY, WITH VALUING MOUNTED IN VERTICAL. COORDINATE EXACT LOCATION WITH ARCHITECT.
2. FIRE SPRINKLER PIPING FOR LOW CEILING. REFER TO FIRE SPRINKLER CONTRACTOR'S SHOP DRAWINGS FOR CONTINUATION.
3. FIRE SPRINKLER PIPING UP FOR GYMNASIUM. REFER TO FIRE SPRINKLER CONTRACTOR'S SHOP DRAWINGS FOR CONTINUATION.
4. SPRINKLER FLOOR CONTROL VALVE. ROUTE DRAIN TO EXTERIOR. SEE DETAIL.
5. DOMESTIC WATER ENTRANCE ASSEMBLE, WITH VALUING MOUNTED IN VERTICAL. PROVIDE DOUBLE BACK FLOW PREVENTER WITHIN THE TENNIS STORAGE AREA. COORDINATE EXACT LOCATION WITH ARCHITECT.
6. 2" VENT AND 1/2" COLD WATER DOWN FOR FLOOR DRAIN. REFER TO DRAWING P02.01 FOR CONTINUATION. TYPICAL.

APPROVED
PLUMBING PLAN
SUBJECT PROVISION OF SEC. 102.2.6 OF THE UNIFORM PLUMBING CODE.
THIS PLAN MUST BE KEPT ON JOB FOR INSPECTORS. SEPARATE PERMIT FOR PLUMBING REQUIRED.
NO. 391

N
0 8'0" 16'0"
SCALE: 1/8" = 1'0"

PLUMBING PLAN 01

STATE OF TEXAS
CRAIG KOEHN
61132
REGISTERED PROFESSIONAL ENGINEER
07/07/07

E/B/E, Inc.
ELECTRICAL/MECHANICAL CONSULTING ENGINEERS
Firm Registration No: 5638
Tel.: (713) 840-0177
Fax: (713) 840-8677

Community Family Centers
Centros Familiares de la Comunidad

John P. McGovern, M.D. Community Sports & Recreation Building
7318 AVENUE F
HOUSTON, TEXAS 77011

THAT'S ARCHITECTURE
2402 COMMONWEALTH #100, HOUSTON, TX 77006
TELEPHONE 713/222-1406 FAX 713/222-1506

ISSUES & REVISIONS	
1	08/07/06 BID AND PERMIT
1	03/07/07 PERMIT COMMENTS

SHEET TITLE
PLUMBING PLAN

PROJECT NO. 06120.00
SCALE AS NOTED

SHEET NUMBER
P02.02